



ELECTRONIC PROGRAMMABLE THERMOSTAT HYGGE

TECHNICAL FEATURES

Power supply:	Battery 2x1.5V \equiv size AAA.	Software class:	A
Size:	78x125x30,5 mm (LxHxD)	Thermoregulation class:	I

INSTALLATION

- 

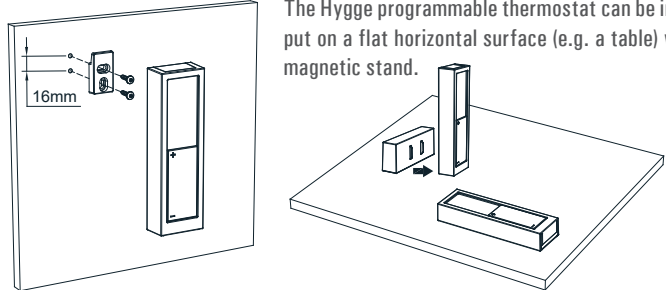Take off the battery compartment cover and correctly insert the featured batteries (according to the correct polarity).
- 


The Hygge programmable thermostat can be installed on a wall or it can be put on a flat horizontal surface (e.g. a table) with or without the provided magnetic stand.

GATEWAY HYGGE WAY

TECHNICAL FEATURES

Power supply:	5V \equiv through power grid plug	Software class:	A
Size:	78x125x30,5 mm (LxHxD)		

INSTALLATION

- 

Connect the provided power adapter, on the back of the device.
- The IoT Gateway is only used stable on a flat surface.

WARNING
Before placing the device on its final position, make sure that the WiFi signal is present and that the device receives the radio signals transmitted by the Hygge programmable thermostat correctly.
- Download the **Seitron Smart app**.
- Start the App, sign in as a new user and make the Login by entering your email and password. Then complete the configuration of the IOT GATEWAY.

HYGGE HOME



Programmable thermostat radio controlled Kit
Weekly programmable



Seitron Smart
Temperatura sotto controllo
Temperature under control




App Android and iOS for Smartphone



Go to www.seitron.com and download the complete manual

Quick guide

LOGIC SYSTEM DIAGRAM

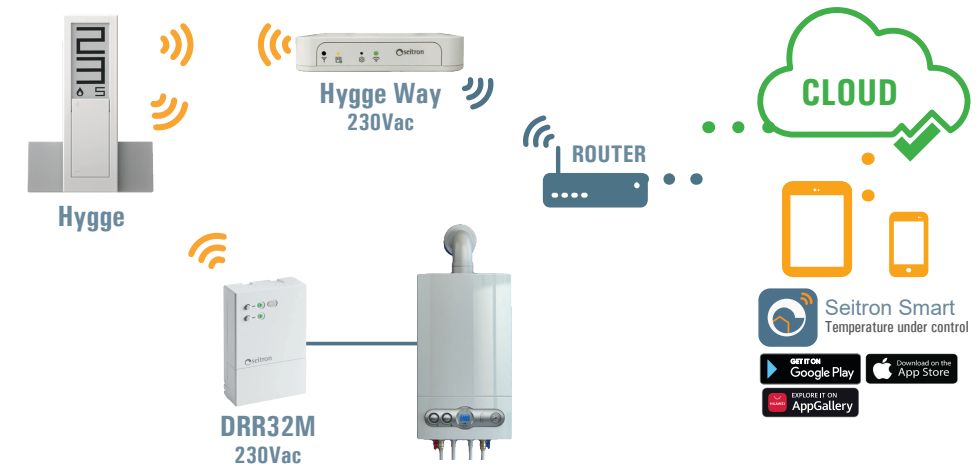

WARNING
THE DEVICES INSIDE THIS KIT ARE FACTORY PRE-MATCHED: ONCE THE MECHANICAL INSTALLATION IS COMPLETE, THEY ARE READY TO USE.

WIST02960ESE 035449 281020

RADIO RECEIVER - DRR32M -

TECHNICAL FEATURES

Power supply:	230V~ 50Hz or 24V~
Contacts rating:	2x6(4)A 250V~ (voltage free)
Type of action:	1.C
Pollution degree:	2
Software class:	A
Rated impulse voltage:	2500V
Ball pressure test temperature:	75°C
EMC test voltage:	230V
EMC test current:	30mA
Size:	78x125x30,5 mm (LxHxD)

INSTALLATION


WARNING!

- Before wiring the appliance be sure to turn the mains power off.
- Before proceeding with the installation of the receiver, make sure that the radio signals transmitted by the thermostats are correctly received by the receiver.
- Installation and electrical wirings of this appliance must be made by qualified technicians and in compliance with the current standards.

1 Cut off mains power.




2



Using a screwdriver, push the plastic flap of the bottom slot and slightly lift the cable lid up.

Fig. 1

3



Rotate the cable lid and remove it completely.

Fig. 2

4

There are three options for the cable entry:

Back cable entry: Open the hole E Fig. 4, with a screwdriver.

Side cable entry: With suitable pliers, remove the plastic teeth, as indicated by arrows in D Fig. 3.

Bottom cable entry: Open one or both holes F Fig. 4, with a screwdriver.

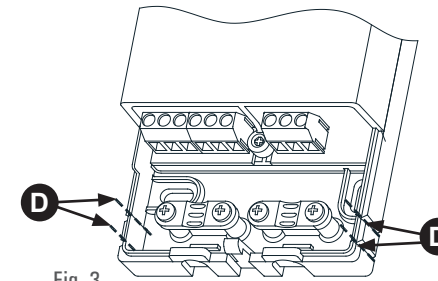


Fig. 3

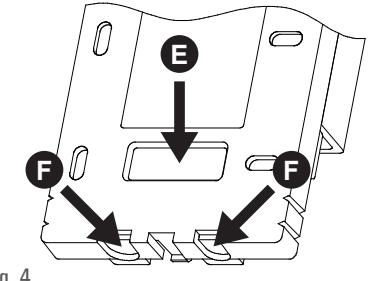


Fig. 4

5

Fix the plate onto the wall using the two screws housings with a 60 mm centre-to-centre distance (use the screws and/or dowels supplied) - Fig. 5.

WARNING!

The receiver must be installed on a wall or on a surface in order to make the back of the product inaccessible.

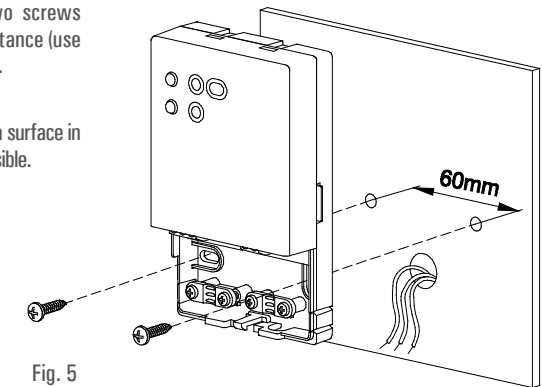


Fig. 5

6

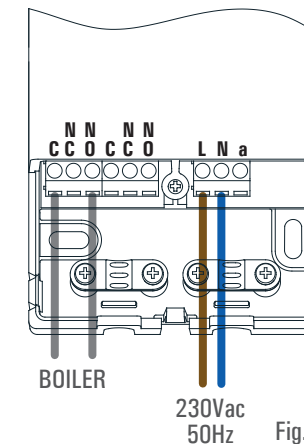


Fig. 6

Make the electrical connections following the paragraph "Electrical connections" of the complete manual.

Below is a simplified connection diagram with the receiver powered at 230Vac.

Where:

Power supply:

L N: Power supply 230V~ 50Hz (Neutral on terminal N)

a N: Power supply 24V~

Relay contacts:

NA: Normally Open Contact

NC: Contact Normally Closed

C: Common

7

Place the cable lid on the base and rotate it towards the base; push the cable lid until the locking plastic flap springs into the hole on the lower side of the cable lid (Fig. 1).

8

Power the receiver back on.

